

FEDERAL AVIATION AGENCY
FLIGHT STANDARDS SERVICE
Washington 25, D. C.

October 12, 1962

REGULATIONS OF THE ADMINISTRATOR DRAFT RELEASE NO. 62-44


SUBJECT: Technical Standard Order C79 "Fire Detectors (Radiation Sensing Type)"

The Flight Standards Service of the Federal Aviation Agency has under consideration an amendment to Part 514 of the Regulations of the Administrator to add a new Technical Standard Order TSO-C79 "Fire Detectors (Radiation Sensing Type)". The reasons therefor are set forth in the explanatory statement of the attached proposal which is being published in the Federal Register as a notice of proposed rule making.

The Flight Standards Service desires that all persons who will be affected by the requirements of the proposal be fully informed as to its effect upon them and is therefore circulating copies in order to afford interested persons ample opportunity to submit comments as they may desire.

Because of the large number of comments which we anticipate receiving in response to this draft release, we will be unable to acknowledge receipt of each reply. However, you may be assured that all comment will be given careful consideration.

It should be noted that comments should be submitted, preferably in duplicate, to the Dockets Section of the Federal Aviation Agency, and in order to insure consideration must be received on or before December 5, 1962.


Acting Director
Flight Standards Service

FEDERAL AVIATION AGENCY

FLIGHT STANDARDS SERVICE

(14 CFR 514)

Regulatory Docket No. 1431; Draft Release No. 62-117

TECHNICAL STANDARD ORDERS FOR AIRCRAFT MATERIALS

PARTS AND APPLIANCES

NOTICE OF PROPOSED RULE MAKING

Pursuant to the authority delegated to me by the Administrator (14 CFR Part 405) notice is hereby given that the Federal Aviation Agency has under consideration a proposal to amend Part 514 of the Regulations of the Administrator by adopting a new Technical Standard Order. This Technical Standard Order establishes minimum performance standards for radiation sensing type fire detectors which are for use on both piston and turbine engine-powered civil aircraft of the United States. For many years, fire detectors of the thermal or flame contact type have been approved under the standards of TSO-C11 covering "Fire Detectors, Thermal and Contact Type". In recent years, however, the fire detector industry has developed detector systems which operate on a different principle involving the sensing of radiated energy (sometimes termed surveillance type detectors). These newer type detectors could not be approved under TSO-C11, nor could minimum airworthiness be assured by reference to any other existing technical standards. This TSO, therefore, has been developed to establish minimum performance requirements for radiation sensing type fire detectors.

Interested persons may participate in the making of the proposed rule by submitting such written data, views or arguments as they may desire. Communications should be submitted in duplicate to the Docket Section of the Federal Aviation Agency, Room A-103, 1711 New York Avenue, N.W., Washington 25, D. C. All communications received on or before December 5, 1962, will be considered by the Administrator before taking action on the proposed rule. The proposals contained in this notice may be changed in light of comments received. All comments submitted will be available in the Docket Section for examination by interested persons at any time.

This amendment is proposed under the authority of Sections 313(a) and 601 of the Federal Aviation Act of 1958 (72 Stat. 752, 775; 49 U.S.C. 1354(a), 1421).

In consideration of the foregoing it is proposed to amend Part 514 as follows:

By adding the following section 514.85:

§ 514.85 Fire detectors (radiation sensing type) - TSO-C79--

(a) Applicability. Minimum performance standards are hereby established for radiation sensing type fire detectors which are for use on both piston and turbine engine-powered civil aircraft of the United States. New models of fire detectors (radiation sensing type) manufactured on or after the effective date of this section, which are to be used on civil aircraft of the United States, shall meet the standards specified in Federal Aviation Agency Standard, "Fire Detectors (Radiation Sensing Type)", dated August 15, 1962.^{1/}

(b) Marking. In lieu of the weight required in § 514.3(d)(3), the operating voltage for the detector shall be shown. Compliance of the detector with the piston or turbine engine requirements, or both, shall be designated by -P, -T, or -PT, respectively, as a suffix following the technical standard order designation as TSO-C79-P.

(c) Data requirements. (1) In addition to the data specified in § 514.2, the manufacturer shall furnish six copies each, except where noted, of the following to the Chief, Engineering and Manufacturing Branch, Flight Standards Division, Federal Aviation Agency, in the region in which the manufacturer is located:

(i) Manufacturer's operating instructions and equipment limitations.

(ii) Installation procedures with applicable schematic drawings, wiring diagrams, and specifications. Indicate any limitations, restrictions, or other conditions pertinent to installation.

(iii) One copy of the manufacturer's test report.

^{1/}Copies may be obtained upon request addressed to Publishing and Graphics Branch, Inquiry Section, MS-158, Federal Aviation Agency, Washington 25, D. C.

(2) The data required under Paragraph (1)(i) and (ii) shall include the following:

(i) Field of vision;

(ii) Maximum effective range at field extremities;


(iii) Maximum allowable normal ambient temperature at the point of detector location;

(iv) Maximum allowable rate of temperature rise at point of detector location as a result of normal operation;

(v) Operating voltage;

(vi) Mounting or support method; and

(vii) Maximum or minimum number of units which can be used in one circuit or one fire zone without adversely affecting sensitivity or causing false indications due to temperature.

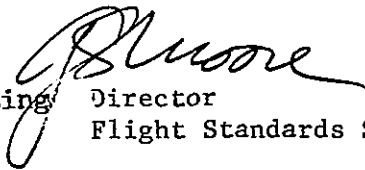
Acting Director
Flight Standards Service

Issued in Washington, D. C., on October 12, 1962.

Federal Aviation Agency Standard

For

Fire Detectors - Radiation Sensing Type

1. Purpose: To specify minimum requirements for powerplant fire detection instruments for use in both piston and turbine engine-powered aircraft, the operation of which may subject the instrument to environmental conditions specified in Paragraph 3.3.
2. Scope: This standard covers the requirements for acceptance of radiation sensing ("surveillance") type fire detectors, intended for use in protecting aircraft powerplant installations, auxiliary powerplants, combustion heaters, and other installations where fuel, oil, or similar fires may occur.
 - 2.1 Definition of Radiation Sensing Type Fire Detectors: An instrument which will initiate an alarm signal when exposed to radiant energy emitted by a flame. The detector and associated circuitry may be designed to be selective with respect to such factors as spectral sensitivity, irradiance level at the detector, rate of rise of irradiance, or frequency characteristics of the fluctuations of irradiance (flicker) or other flame characteristic.
3. General Requirements
 - 3.1 Materials and Workmanship
 - 3.1.1 Materials: Materials shall be of a quality which experience and/or tests have demonstrated to be suitable and dependable for use in aircraft instruments.
 - 3.1.2 Workmanship: Workmanship shall be consistent with high-grade aircraft instrument manufacturing practice.
 - 3.2 Blank
 - 3.3 Environmental Conditions: The following conditions have been established as design minimum requirements. Tests shall be conducted as specified in Sections 5, 6 and 7.
 - 3.3.1 Temperature: When installed in accordance with the manufacturer's recommendations, the instrument shall function over the range of ambient temperatures shown in Column A below and shall not be adversely affected by exposure to the temperatures shown in Column B below:

<u>Instrument Location</u>	<u>A</u>	<u>B</u>
Powerplant Compartment(Piston)	-30 to 130C	-65 to 130C
Powerplant Compartments(Turbine)	-30 to 150C	-65 to 150C
Pressurized Areas (Both types)	-30 to 50C	-65 to 70C
Nonpressurized or External Areas(of engine)	-55 to 70C	-65 to 70C

If instrument is intended for use in compartments where maximum ambient is higher than 130° C for piston engines and 150° C for turbine engines, appropriate special limits shall be selected for Columns A and B, and specified by the manufacturer.

3.3.2 Humidity: The instrument shall function and shall not be adversely affected when exposed to any relative humidity in the range from 0 to 95 percent at a temperature of approximately 70° C.

3.3.3 Altitude: When installed in accordance with the instrument manufacturer's instructions, the instruments shall function from sea level up to the altitudes and temperatures listed below. Altitude pressures are per NACA Report 1235.

Instrument Location

Powerplant Accessory Compartment	50,000'	(80C)
Pressurized Areas	15,000'	(50C)
Nonpressurized Areas	50,000'	(20C)

The instrument shall not be adversely affected following exposure to extremes in ambient pressure of 50 inches, and 3 inches, of mercury absolute, respectively.

3.3.4 Vibration: When installed in accordance with the instrument manufacturer's instructions, the instrument shall function and shall not be adversely affected when subjected to vibrations of the following characteristics:

<u>Frequency</u> <u>Cycles</u> <u>Per Sec.</u>	<u>Max. Double</u> <u>Amplitude</u> <u>in Inches</u>	<u>Maximum</u> <u>Acceleration</u>
--	--	---------------------------------------

Piston Engines

Airframe Structure Mounted	5-500	.050	10g
Shock-Mounted Panel	5-50	.020	1.5g
Powerplant Mounted	5-500	.100	20g

Turbine Engines

Nacelle and Nacelle Mounts, Wings, Empen- nage and Wheel Wells	5-1000	0.036	10g
Fuselage			
Forward of Spar Area	5-500	0.036	2g
Center of Spar Area	5-1000	0.036	4g
Aft of Spar Area	5-500	0.036	7g
	500-1000	----	5g
Vibration Isolated	5-50	0.020	1.5g
Racks	50-500	----	0.5g
Instrument Panel	5-500	.030	1.0g

3.3.5 Powerplant Compartment Fumes and Gases

Fumes, gases or combustion products accumulating within the powerplant compartments either during normal or malfunctioning powerplant conditions, including a compartment fire, shall not adversely affect the capability of the detector units to sense the initial or a reignited fire.

3.4 Radio Interference: The instrument shall not be the source of objectionable interference, under operating conditions at any frequencies used on aircraft, either by radiation or feedback, in electronic equipment installed in the same aircraft as the instrument.

3.5 Magnetic Effect: The magnetic effect of the instrument shall not adversely affect the operation of other instruments in the same aircraft.

4. Detail Requirements:

4.1 Indication Means: The instrument shall be capable of actuating visual and/or aural alarm indicators.

4.2 Reliability: The instrument shall be designed to withstand the mechanical and thermal shocks, and stresses incident to its use in aircraft. False alarm signals shall not result from variations in voltage encountered during operation of the aircraft, abnormal attitudes, contaminants in the atmosphere, ambient light conditions, acceleration forces encountered during flight, landing and takeoff. The fire detector shall not false alarm and the detector sensitivity shall not be appreciably affected by the ambient light in the aircraft compartment in which the sensor is installed, under any combination of normal aircraft operating conditions and atmospheric conditions. Tests aimed at determining the effects of the foregoing factors on detector reliability are described in Section 7.3.

- 4.3 Integrity Test Means: The instrument shall be designed to provide a means for testing the continuity and functioning of the electrical circuits in flight.
- 4.4 Calibration Means: The instrument shall be designed so that all calibration means are provided with tamper-proof seals.
- 4.4.1 Adjustable Detector Systems: Instruments which incorporate an adjustment means shall be tested to prove compliance with this standard, particularly paragraphs 7.1, 7.1.1 and 7.3 throughout the range of adjustability.
5. Test Conditions:
- 5.1 Atmospheric Conditions: Unless otherwise specified, all tests required by this standard, shall be conducted at an atmospheric pressure of approximately 29.92 inches of mercury and at an ambient temperature of approximately 25C and at a relative humidity of not greater than 85 percent. When tests are conducted with the atmospheric pressure or the temperature substantially different from these values, allowance shall be made for the variation from the specified conditions.
- 5.2 Vibration: (To minimize friction): Unless otherwise specified, all tests for performance may be conducted with the instrument subjected to a vibration of 0.002 to 0.005 inch double amplitude at a frequency of 1500 to 2000 cycles per minute. The term double amplitude as used herein indicates the total displacement from positive maximum to negative maximum.
- 5.3 Vibration Equipment: Vibration equipment shall be such as to allow vibration to be applied along each of three mutually perpendicular axes of the instrument at frequencies and amplitudes consistent with the requirements of Paragraph 3.3.4.
- 5.4 Power Conditions: Unless otherwise specified, all tests shall be conducted at a power rating recommended by the manufacturer.
- 5.5 Test Position: Unless other specified, the instrument shall be mounted and tested in its normal operating position.

6. Individual Performance Requirements: All instruments or components of such shall be subjected to tests by the manufacturer to demonstrate specific compliance with this standard (that production articles comply with this standard) including the following requirements where applicable.

6.1 Sensitivity and Calibration: The sensor shall be tested as specified in paragraph 7.1, to determine the response sensitivity and calibration.

6.2 Dielectric: Each instrument shall be tested by the methods of inspection listed in Paragraphs 6.2.1 and 6.2.2.

6.2.1 Insulation Resistance: The insulation resistance measured at 200 volts D.C. for five seconds between all electrical circuits connected together and the metallic case shall not be less than 5 megohms. Insulation resistance measurements shall not be made to circuits where the potential will appear across elements such as windings, resistors, capacitors, etc., since this measurement is intended only to determine adequacy of insulation.

6.2.2 Overpotential Tests: Equipment shall not be damaged by the application of a test potential between electrical circuits, and between electrical circuits and the metallic case. The test potential shall be a sinusoidal voltage of a commercial frequency with an r.m.s. value of five times the maximum circuit voltage or per paragraphs 6.2.2.1 or 6.2.2.2, whichever applies. The potential shall start from zero and be increased at a uniform rate to its test value. It shall be maintained at this value for five seconds, and then reduced at a uniform rate to zero.

Since these tests are intended to assure proper electrical isolation of the circuit components in question, these tests shall not be applied to circuits where the potential will appear across elements such as windings, resistors, capacitors, etc.

6.2.1 Hermetically sealed instruments shall be tested at 200 volts r.m.s.

6.2.2 Circuits that operate at potentials below 15 volts are not to be subjected to overpotential tests.

7. Qualification Performance Requirements: As many instruments as deemed necessary to demonstrate that all instruments will comply with the requirements of this section shall be tested in accordance with the manufacturer's recommendations. The tests on each instrument shall be conducted consecutively in the order listed, and after the tests have been initiated, further adjustments

to the instrument shall not be permitted. A false alarm signal occurring during any of the tests shall disqualify the instrument from further testing. A response time test per paragraph 7.1 shall be conducted after each test, except paragraphs 7.2, 7.2.1, 7.2.3 and 7.14. In conducting the test of paragraph 7.14, the instrument(s) tested need not be the same instrument(s) being subjected to the entire series of qualification tests.

- 7.1 Response Time: The sensor of the instrument shall be exposed, at a distance of four feet to a test flame produced by burning gasoline in a flat pan five inches in diameter and with a flow of air of ten feet per second maximum. The temperature of the gasoline and the pan at the start of each test shall not exceed 85° F. A non-leaded white gasoline shall be used. The response time shall not exceed five seconds.
- 7.1.1 Saturation Test: The sensor shall be mounted approximately three inches above the center of a flat pan, two feet in diameter, containing gasoline to a level of 1/8-inch from the bottom. The gasoline shall be ignited by a source that cannot be detected by the sensor. The response time shall not exceed five seconds, and the system shall not clear the alarm while exposed to this test for a period of one minute.
- 7.1.2 Repeat Response Time: The sensor of the fire detector shall be exposed to the flame as described in 7.1 above, for a period of one minute. It shall then be prevented from sensing the flame. Within five seconds after the alarm has cleared, the sensor shall again be exposed to the flame. An alarm shall be signalled within five seconds.
- 7.2 False Alarm Due to Rate of Temperature Rise: The tests described in 7.2.1 and 7.2.2 below, shall be conducted in a temperature-controlled airflow moving at a velocity of 250 feet per minute plus or minus 25 feet per minute. The instrument for this test shall consist of a control unit complete with the maximum number of sensors to be used with a single control unit. No alarm signal shall occur.
- 7.2.1 Local Temperature Rise: One sensor shall be subjected to various combinations of rates of temperature rise and duration of those rates of rise shown in the shaded area of Figure 3(a). The other sensors in the system shall be maintained at ambient room temperature. This test shall be conducted simulating conditions due to local overheating. No alarm signal shall occur.

- 7.2.2 General Temperature Rise: The test described in 7.2.1 above shall be repeated using Figure 3(b) except that all the sensors shall be subjected to the temperature variations simultaneously. The test shall be conducted simulating conditions due to a general temperature rise throughout the compartment where the sensors are located. No alarm signal shall occur.
- 7.2.3 False Clearing of Alarm Due to Partial Extinguishment of Fire: With the instrument arranged to test the response time, in accordance with 7.1 above, the test flame shall be applied for 30 seconds. The test flame shall then be masked so as to reduce its effective area by approximately 50 percent. The alarm signal shall not clear. After an additional 30 seconds, the flame shall be removed entirely, and the alarm signal shall clear within 10 seconds.
- 7.3 Test Procedures to Establish Detector Reliability Under Special Environmental Conditions: The following test procedures shall apply to establish detector system reliability under various adverse conditions. In conducting the tests, the system shall contain the critical number of sensors for the specific test condition.
- 7.3.1 Blank
- 7.3.2 Magnesium Flame: A 6" length of magnesium metal ribbon approximately 1/8" wide and 0.005" thick, is to be clamped to a support at one end so that it extends out into the air horizontally. The detector is placed 2' from it at the same level, so that it views it sidewise. First run the gasoline pan fire test (7.1) at the 4' distance, and then, while the alarm light is on, ignite the magnesium simultaneously, at the 2' distance and in line between the detector and the pan fire. The alarm light must stay on, at least while the gasoline is burning.
- 7.3.3 Sunlight: This test shall be made with sunlight shining directly on the detector (not through a closed window) and the sun shall be within 45° of the zenith so that the slant path through the atmosphere will not be too long. The illumination shall be 5,000 foot-candles or greater, with the light meter probe facing the sun. The detector shall be exposed to sunlight for 30 seconds and must not alarm.
- 7.3.4 Chopped Sunlight: In this test, the sunlight (see 7.3.3) shall be modulated by a shutter blade system over a frequency range of 100 cycles per second to 0 cycles per second. This frequency range shall be swept out over a sufficient duration so that there will be a dwell time of a few seconds in any frequency band over the range. A satisfactory chopping arrangement would be a four-bladed shutter on the shaft of a small universal-wound

motor operating from a Variac or other source of adjustable voltage. The shutter blades must be large enough to obscure the sun completely from the detector when they are in front of the detector, and blades should be not more than 1" away from the detector so that the light from the sky itself will also be modulated. No alarms shall result from the above testing.

7.3.5 Sunsets and Signal Lights: An array of colored, incandescent light bulbs shall be used to simulate the colorimetric properties of sunsets at several stages. (This test would also take care of identification and marker lights, and red side of a beacon light, and the revolving red side on the belly of the airplane that flicks past the powerplants). The bulbs shall be 40-watt yellow, orange, and red ones such as General Electric Nos. 40 A/Y, 40 A/O, and 40 A/R, or equivalent. The test is to be conducted in subdued room illumination of not more than one-foot candle on the detector (too dim to read fine print). The test shall comprise an exposure of the detector to each of the three lamps, at 3 feet, for 30 seconds each, without causing an alarm.

7.4 Vibration:

Resonance: The instrument, while operating, shall be subjected to a resonant frequency survey of the appropriate range specified in paragraph 3.3.4 in order to determine if there exists any resonant frequencies of the parts. The amplitude used may be any convenient value that does not exceed the maximum double amplitude and the maximum acceleration specified in paragraph 3.3.4.

The instrument shall then be subjected to vibration at the appropriate maximum double amplitude or maximum acceleration specified in paragraph 3.3.4 at the resonant frequency for a period of one hour in each axis.

When more than one resonant frequency is encountered with vibration applied along any axis, a test period may be accomplished at the most severe resonance or the period may be divided among the resonant frequencies, whichever shall be considered most likely to produce failure. The test period shall not be less than one-half hour at any major resonant mode.

When resonant frequencies are not apparent within the specified frequency range, the instrument shall be vibrated for two hours in accordance with the vibration requirements schedule (Section 3.3.4) at the maximum double amplitude and the frequency to provide the maximum acceleration.

Cycling: The instrument, while operating, shall be tested with the frequency cycled between limits specified in Section 3.3.4 in 15-minute cycles for a period of one hour in each axis at an applied double amplitude specified in Paragraph 3.3.4 or an acceleration specified in 3.3.4 whichever is the limiting value.

7.5 Water Spray: The instrument components which are to be located outside the pressurized area of the aircraft shall be subjected to the following tests:

7.5.1 Simulated Rain: The component shall be subjected to a spray of water to simulate rain for a period of three hours. The component shall not be dried prior to testing, per Paragraph 7.1.

7.5.2 Salt Spray: The instrument components which are to be installed in exposed portions of the aircraft shall be subjected to a finely atomized spray of 20 percent sodium chloride solution for 50 hours. At the end of this period, the component shall be allowed to dry and shall be tested per Paragraph 7.1.

7.6 Humidity: The instrument shall be mounted in a chamber maintained at a temperature of $70 \pm 2\text{C}$ and a relative humidity of $95 \pm 5\%$ for a period of six hours. After this period, the heat shall be shut off and the instrument shall be allowed to cool for a period of 18 hours in this atmosphere in which the humidity rises to 100% as the temperature decreases to not more than 38C . This complete cycle shall be conducted:

- a. Five times for components located in uncontrolled temperature areas.
- b. Once for components located in controlled temperature areas.

Immediately after this cycling, there shall be no evidence of damage or corrosion which affects performance.

7.7 Fuel and Oil Immersion: The instrument components which are to be installed in engine compartments or other locations in the aircraft where they may be contaminated by fuel or oil shall be subjected to the following tests:

- 7.7.1 Fuel Immersion: The component shall be thoroughly immersed in normally leaded 100 octane fuel or turbine engine fuel as appropriate, at room temperature and then allowed to drain for one (1) minute before being tested, per Paragraph 7.1. No cleaning other than the drainage as specified shall be accomplished prior to conducting subsequent tests.
- 7.7.2 Oil Immersion: The test procedure outlined in Paragraph 7.7.1 shall be conducted with used MIL-O-7808 oil (turbine engine oil) or SAE #50 (piston engine oil) as appropriate.
- 7.8 Sand: The instrument components which are to be located in externally exposed portions of the aircraft (such as in nacelles, wheel wells, etc.) shall be subjected to a sand-laden airstream flowing at a constant rate of 2-1/2 pounds of sand per hour for four (4) hours. The airstream shall be formed of sand that has been sifted through a 150 mesh screen and the particles shall come in contact with all parts of the component being tested. The test chamber shall be equivalent to that shown in Figure 1.
- 7.9 High Temperature Operation: The instrument shall be subjected to the applicable high ambient temperature listed in Column A of table in Paragraph "3.3.1 Temperature: for a period of 48 hours (electrical equipment energized). Where the highest recommended operating temperature exceeds those of Column A, this higher temperature shall be used. The instrument shall meet, while at that temperature (s), the performance tests described in Paragraphs 7.1 and 7.1.1.
- 7.10 Low Temperature Operation: Same as requirement 7.9 above, except substitute "low" for "high". The instrument shall then meet, at that temperature, the performance tests described in Paragraphs 7.1 and 7.1.1.
- 7.11 Altitude Effects
- 7.11.1 High Altitude and Rate of Climb: The instrument shall be subjected to a pressure that is varied from normal atmospheric pressure to an altitude pressure equivalent to 50,000 feet at a rate of not less than 3,000 feet per minute. The instrument shall be maintained at the altitude pressure equivalent to 50,000 feet for a period of 48 hours. The instrument shall then be returned to sea level conditions and then tested per Paragraphs 7.1 and 7.1.1. Sealed components shall not leak as a result of exposure to this pressure and a leak test shall be demonstrated by immersion in water or equivalent.

- 7.11.2 Low Altitude: The instrument shall be subjected to the same test as outlined in Paragraph 7.11.1, except that the pressure shall be maintained at an altitude pressure equivalent to -1000 feet and that the rate of pressure variation need not be as specified therein.
- 7.11.3 Pressurization Test: The components which are to be located in a pressurized area shall be subjected to an external pressure of 50 inches of mercury absolute for a period of 15 minutes. The response time test of the instrument per Paragraph 7.1 shall be conducted while the component involved is under this pressure.
- 7.12 Voltage Variation: The instrument shall be operated with the voltage cycled between 75 and 110 percent of the rated voltage. The instrument shall then be tested per Paragraph 7.1 under these conditions. Compliance with the provisions of Paragraph 4.2 shall also be demonstrated.
- 7.13 Clearance Time: The instrument shall be exposed to the flame as described in Paragraph 7.1 and three determinations made of the time required for the signal to clear. This shall be accomplished by obtaining a response, and immediately turning the instrument so that it ceases to sense (view) the fire, and the time required for the signal to disappear obtained. This time duration is the "clearance time". It must not exceed 10 seconds. During this test, the sensor shall be subjected to the most critical vibration (frequency and amplitude conditions as determined in 7.4).
- 7.14 Fire Resistance: For instrument sensing components, including detectors and connecting electrical wire, which are to be installed in a fire zone, tests shall be conducted to show resistance to a completely enveloping flame of 1100° C, minimum for two periods of one minute each. The flame shall be as specified in Figure 2. The sensor shall be cooled to room temperature after each exposure to flame. The instrument shall then be exposed to the same flame for a third time. An alarm shall be signalled in not more than five seconds after each of the exposures. The instrument shall produce alarm clearance in not more than 45 seconds after the flame has been removed in the first two cases. Artificial means of cooling the instrument shall not be used until after the alarm has cleared.

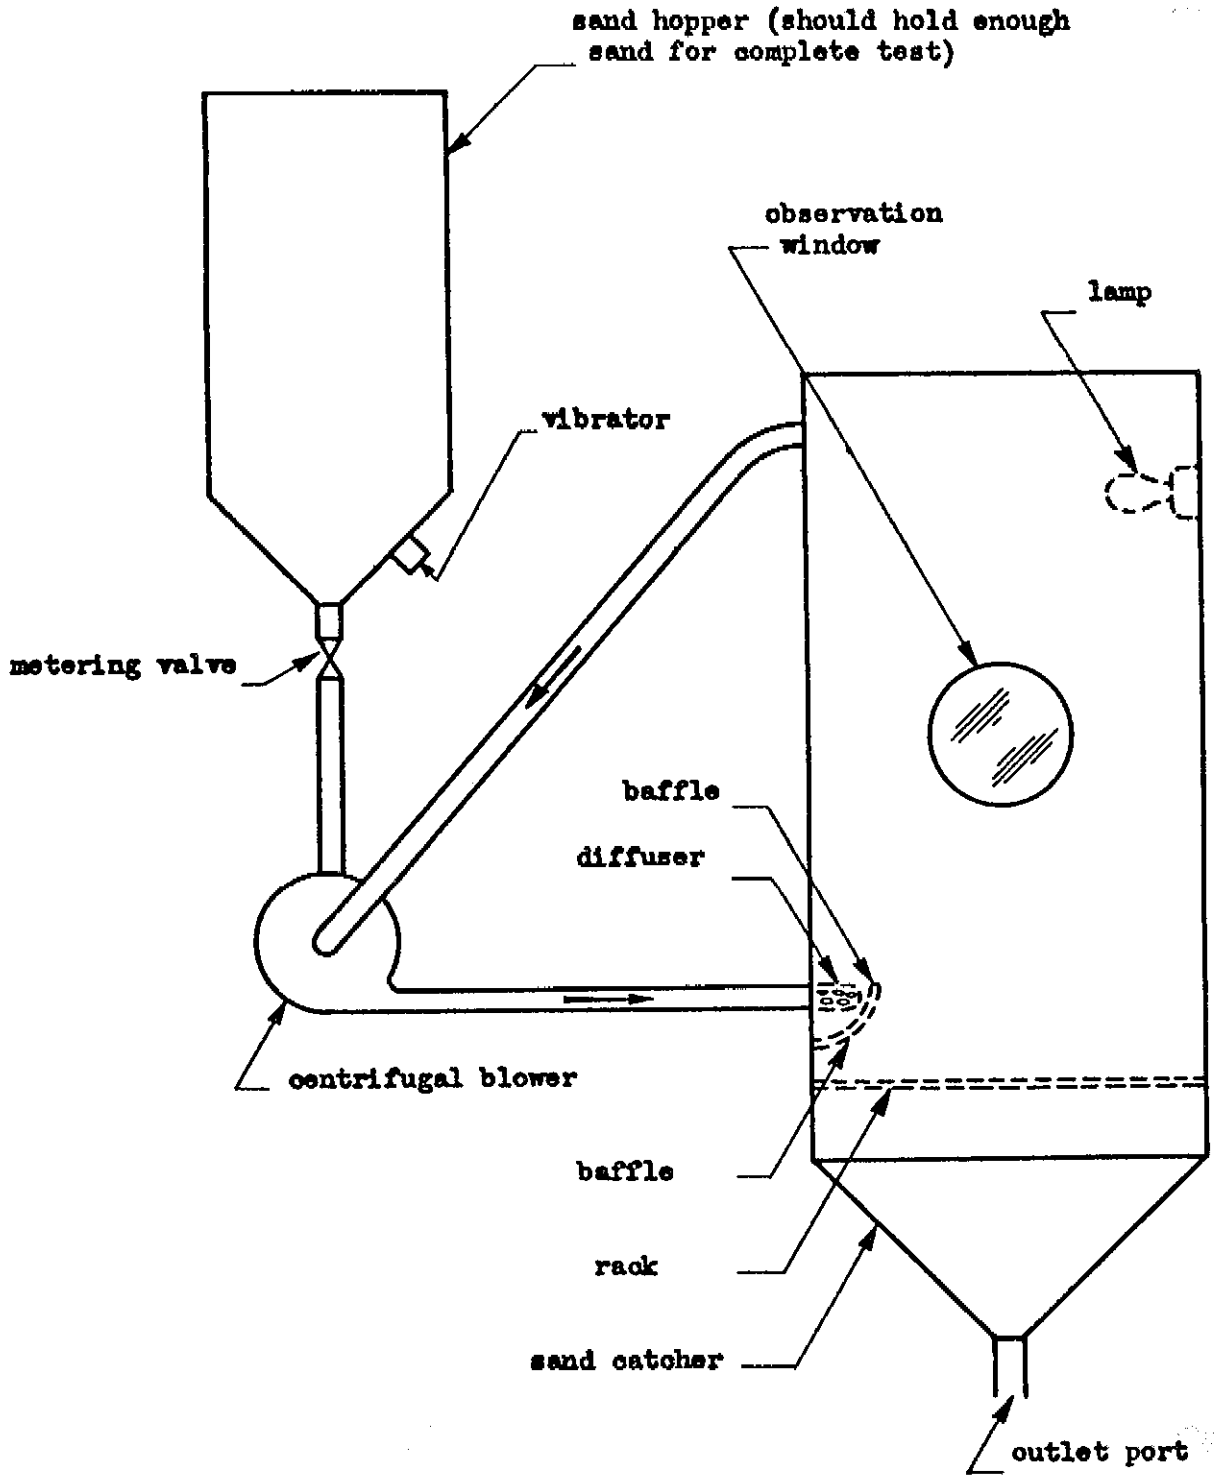


FIGURE 1
Schematic Sand Test Arrangement (Ref. Section 7.8)

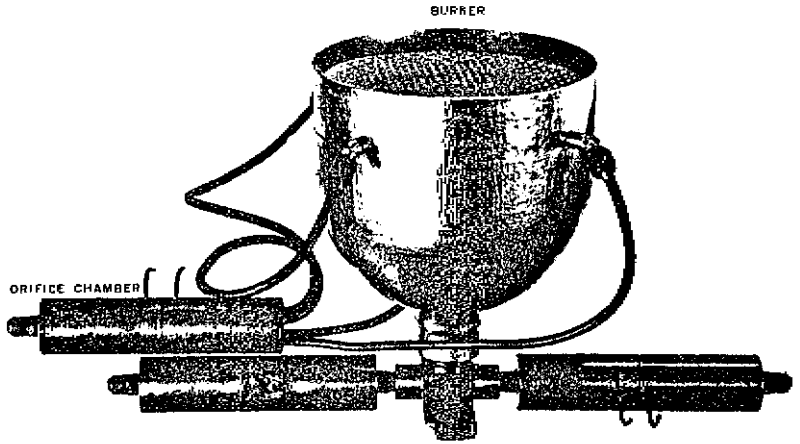


Figure 2-1. Standard Burner Assembly

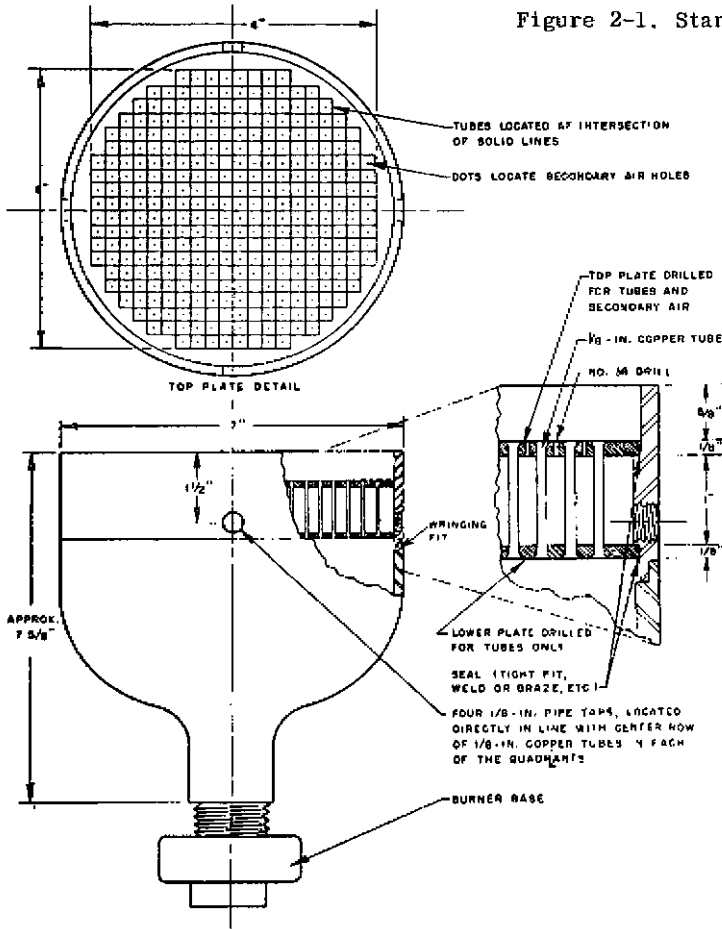


Figure 2-2. Standard Burner

Standard Burner Assembly.

The complete standard burner assembly is shown in Fig. 2-1. Details of the components of this assembly are given in Figs. 2-2, 2-3, and 2-4.

Fig. 2-2 shows the details of the burner and the burner grill which consists of two plates connected by 1/8-inch copper tubes. Gas and air are mixed in the burner base and travel upward through the tubes. The burning takes place above the top plate of the burner. Cooling air is admitted to the burner through the four 1/8-inch pipe-tapped holes between the plates of the burner

grill. This air passes upward through the No. 38 drill holes in the top plate and serves as a means for controlling the overall temperature of the flame. The location of the four 1/8-inch pipe-tapped holes is critical. They must be located directly in line with the center row of 1/8-inch copper tubes in each of the four quadrants. Improper location of these connections will result in an unequal radial distribution of cooling air and will affect the distribution of the flame temperature in a like manner.

Fig. 2-3 shows the details of the burner base. When the two 11/32-inch-diameter holes in the burner plug are drilled, care should be taken that the center line connecting these holes will be at right angles to the center line connecting the two 19/64-inch diameter holes in the base. When these 11/32-inch diameter holes are properly located, the 19/64-inch-diameter holes cannot be seen when one looks vertically downward into the burner base. This misalignment of holes aids in the mixing of the gas and air before they ascend to the burner grill.

Fig. 2-4 shows the details of an orifice and of an orifice chamber. Three are required. Two of these orifice chambers have end plates with the 3/8-inch Parker thread fittings on both ends and are fastened directly into the burner base. The third orifice chamber has an end plate with a Parker thread fitting on one end and the plate with four 1/4-inch-diameter holes in the other end. This end of the chamber is connected to the burner by four copper tubes, each 1/4 inch in outside diameter (OD) and 13 1/2 inches long. One of the orifice chambers connected to the base is for measuring the gas supplied to the burner and has an orifice 5/32 (0.01625) inch in diameter. The other orifice chamber connected to the base is for measuring the mixing air supplied to the burner and has an orifice 1/4 (0.25) inch in diameter. The third orifice chamber connected to the burner by four 1/4-inch OD copper tubes is for measuring cooling air supplied to the burner and has an orifice 5/16 (0.3125) inch in diameter.

The gas should deliver approximately 2500 British thermal units (BTU) per cubic foot. The burner should consume 26 cubic feet of gas per hour for the 2000°F (1100°C) flame. The flame produced should be uniform and steady with no yellow tips.

The differential manometer readings of the pressure drops across the orifice should be:

1. Gas orifice (5/32-inch diameter), 0.99 inch of water.
2. Mixing-air orifice (1/4-inch diameter), 9.25 inches of water.
3. Cooling-air orifice (5/16-inch diameter), 11.0 inches of water.

In order that the burner might produce the right amount of heat, the differential pressure for the gas and the mixing air should be accurately controlled. A slight variation in the cooling air may be necessary in order to obtain the proper temperature.

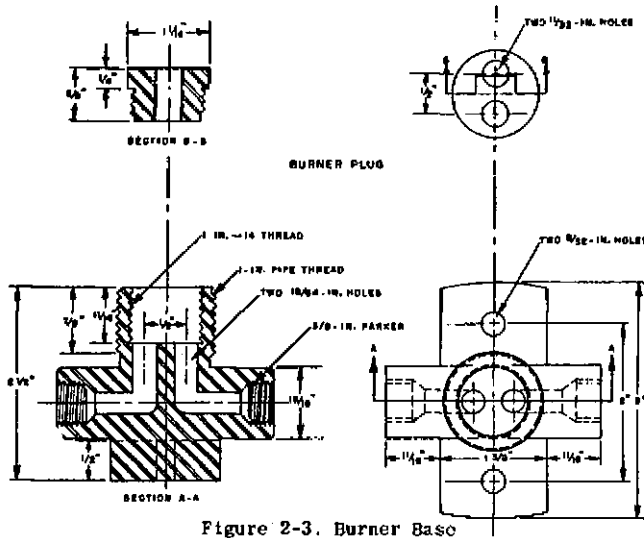


Figure 2-3. Burner Base

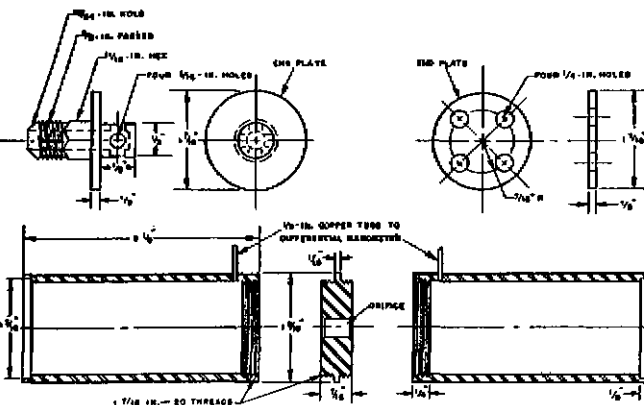


Figure 2-4. Orifice Chamber

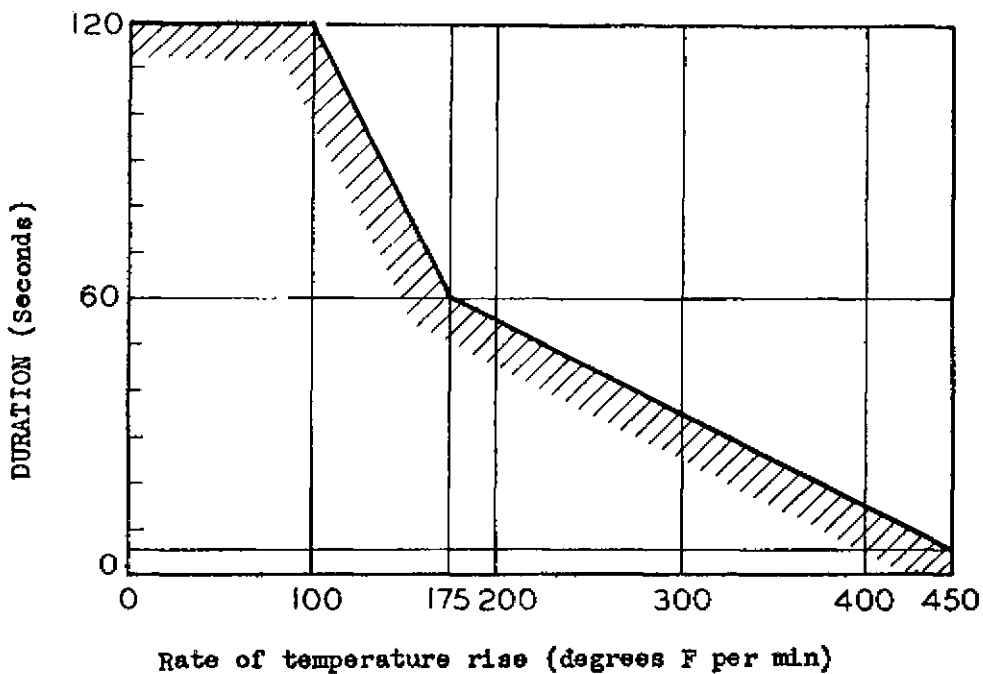


FIGURE 3 (a)

Local temperature rise condition
(Ref. Section 7.2.1)

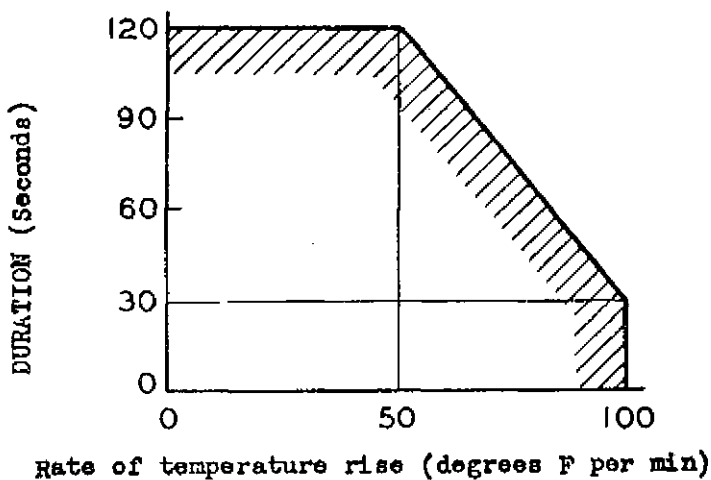


FIGURE 3 (b)

General temperature rise condition
(Ref. Section 7.2.2)